



FLUROPON[®]

CERTIFIED LABORATORY TEST REPORT

IMPACT RESISTANCE

TEST PROCEDURES:

REVERSE IMPACT USING 2X METAL THICKNESS IN INCH LBS. (KILOGRAM-METERS) ½ INCH (13MM) BALL INDENTER (GARDNER IMPACT TESTER) PER ASTM D 2794

PRODUCT TESTED:

FLUROPON[®]

SUBSTRATE:

HDG, GALVALUME

TEST RESULTS:

ACCEPTABLE

- NO CRACKING
- NO LOSS OF ADHESION

LOCATION:

THE SHERWIN-WILLIAMS COMPANY
FT. MYERS, FLORIDA, USA


Marlene Garrow
Group Leader


05/30/2019

Date


Alexander J. Nicol
Notary Public

5/30/19

Date

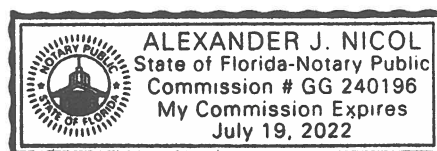

Notary Public stamp with expiration date

The SHERWIN-WILLIAMS COMPANY certifies these tests to be true, accurate and performed by our laboratory.