



SHERWIN-WILLIAMS
Coil Coatings

FLUROPON[®]

CERTIFIED LABORATORY TEST REPORT

SURFACE BURNING

TUNNEL TEST

TEST PROCEDURES:

SURFACE BURNING CHARACTERISTICS OF
BUILDING MATERIALS - ASTM E 84

PRODUCT TESTED:

FLUROPON[®]

TEST RESULTS:

RESULTS ARE EXPRESSED AS RATIO WITH
STANDARD MATERIALS:
REINFORCED CEMENT BOARD =0
RED OAK FLOORING =100

FILM APPEARANCE:

PANEL #1 – COATED ALUMINUM

PANEL #1

FLAME SPREAD INDEX: 5
SMOKE DEVELOPED INDEX: 0

NATIONAL FIRE PROTECTION ASSOCIATION HAS ADOPTED THE FOLLOWING
SURFACE BURNING CLASSIFICATION SYSTEM BASED ON TUNNEL TEST FLAME
SPREAD RATIO:

CLASS A – 0-25
CLASS B – 25-75
CLASS C – 75-100


FLUROPON[®] SYSTEM RATES CLASS A

LOCATION:

NGC TESTING SERVICE
BUFFALO, NY

Marlene Garrow 05/30/2019
Marlene Garrow Date
Group Leader

Alexander J. Nicol 5/30/19
Alexander J. Nicol Date
Notary Public

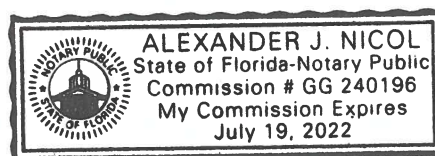

Notary Public stamp with expiration date

The SHERWIN-WILLIAMS COMPANY certifies these tests to be true, accurate and performed by our laboratory.